


Data: 86

Date: 2019-03-12 Time: 09:57:21

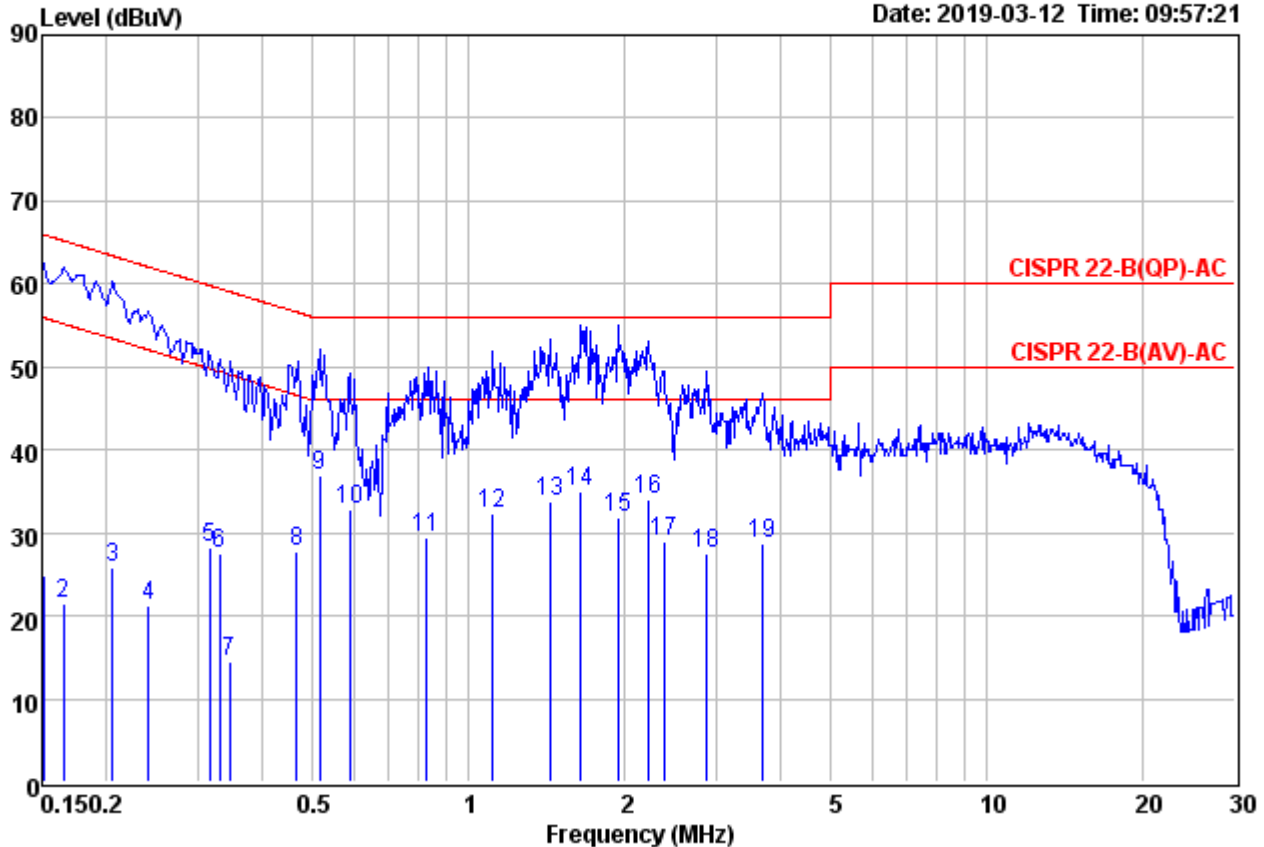

Site : site
 Condition : CISPR 22-B(QP)-AC LINE
 EUT : SKBB PSU 2nd source
 Test Mode : 220V/60Hz; 5V/1.6A
 Remark : Dummy load with Earth GND
 Sample No. :
 S/N :
 Test by : Martin Chang

	Read Freq	Level	LISN Factor	Cable Loss	Level	Limit Line	Over Limit	Pol/Phase	Remark
	MHz	dBuV	dB	dB	dBuV	dBuV	dB		
1	0.15	24.87	0.00	0.10	24.97	55.95	-30.98	LINE	Average
2	0.16	21.44	0.00	0.10	21.54	55.22	-33.68	LINE	Average
3	0.20	25.79	0.00	0.11	25.90	53.41	-27.51	LINE	Average
4	0.24	21.17	0.00	0.11	21.28	52.08	-30.80	LINE	Average
5	0.32	28.02	0.00	0.12	28.14	49.83	-21.69	LINE	Average
6	0.33	27.34	0.00	0.12	27.46	49.43	-21.97	LINE	Average
7	0.34	14.27	0.00	0.12	14.39	49.09	-34.70	LINE	Average
8	0.47	27.62	0.00	0.13	27.75	46.59	-18.84	LINE	Average
9	0.52	36.68	0.00	0.14	36.82	46.00	-9.18	LINE	Average
10	0.59	32.73	0.00	0.14	32.87	46.00	-13.13	LINE	Average
11	0.83	29.37	0.00	0.15	29.52	46.00	-16.48	LINE	Average
12	1.11	32.22	0.00	0.16	32.38	46.00	-13.62	LINE	Average
13	1.43	33.64	0.00	0.16	33.80	46.00	-12.20	LINE	Average
14	1.64	34.93	0.00	0.17	35.10	46.00	-10.90	LINE	Average
15	1.94	31.62	0.00	0.17	31.79	46.00	-14.21	LINE	Average
16	2.21	33.79	0.00	0.18	33.97	46.00	-12.03	LINE	Average
17	2.37	28.86	0.00	0.18	29.04	46.00	-16.96	LINE	Average
18	2.87	27.25	0.00	0.18	27.43	46.00	-18.57	LINE	Average
19	3.68	28.62	0.00	0.19	28.81	46.00	-17.19	LINE	Average