


Data: 90

Date: 2019-03-12 Time: 11:41:03

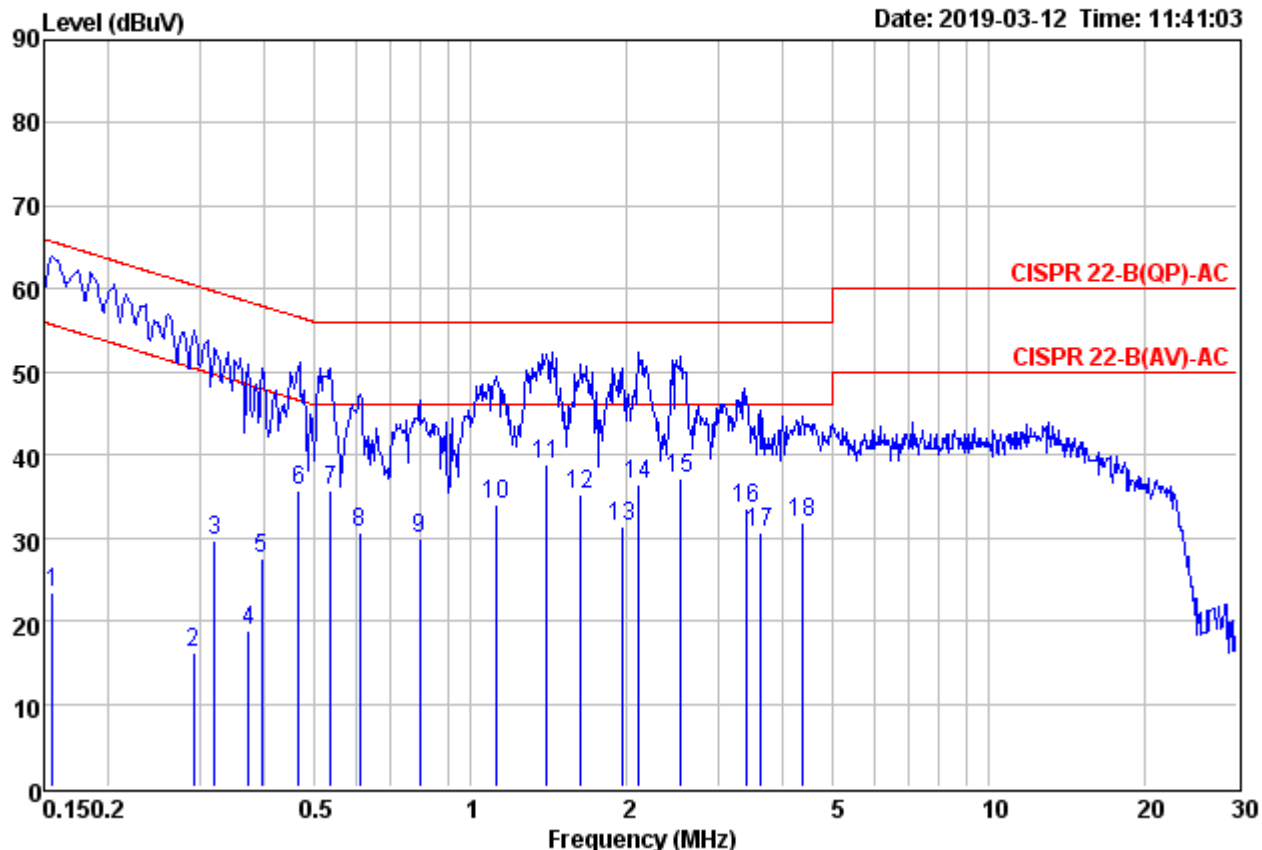

Site : site
 Condition : CISPR 22-B(QP)-AC LINE
 EUT : SKBB PSU 2nd source
 Test Mode : 220V/60Hz; 5V/1.6A
 Remark : Dummy load with Earth GND
 Sample No.: 04
 S/N : EdiTech / TYPE2541
 Test by : Martin Chang

	Read Freq	Level	LISN Factor	Cable Loss	Level	Limit Line	Over Limit	Pol/Phase	Remark
	MHz	dBuV	dB	dB	dBuV	dBuV	dB		
1	0.16	23.32	0.00	0.10	23.42	55.69	-32.27	LINE	Average
2	0.29	16.01	0.00	0.12	16.13	50.50	-34.37	LINE	Average
3	0.32	29.66	0.00	0.12	29.78	49.70	-19.92	LINE	Average
4	0.37	18.75	0.00	0.13	18.88	48.47	-29.59	LINE	Average
5	0.40	27.38	0.00	0.13	27.51	47.96	-20.45	LINE	Average
6	0.47	35.57	0.00	0.13	35.70	46.59	-10.89	LINE	Average
7	0.53	35.66	0.00	0.14	35.80	46.00	-10.20	LINE	Average
8	0.61	30.56	0.00	0.14	30.70	46.00	-15.30	LINE	Average
9	0.79	29.68	0.00	0.15	29.83	46.00	-16.17	LINE	Average
10	1.12	33.87	0.00	0.16	34.03	46.00	-11.97	LINE	Average
11	1.40	38.60	0.00	0.16	38.76	46.00	-7.24	LINE	Average
12	1.63	35.02	0.00	0.17	35.19	46.00	-10.81	LINE	Average
13	1.96	31.26	0.00	0.17	31.43	46.00	-14.57	LINE	Average
14	2.11	36.31	0.00	0.18	36.49	46.00	-9.51	LINE	Average
15	2.54	37.02	0.00	0.18	37.20	46.00	-8.80	LINE	Average
16	3.38	33.33	0.00	0.19	33.52	46.00	-12.48	LINE	Average
17	3.61	30.54	0.00	0.19	30.73	46.00	-15.27	LINE	Average
18	4.37	31.63	0.00	0.20	31.83	46.00	-14.17	LINE	Average