


Data: 87

Date: 2019-03-12 Time: 10:19:09

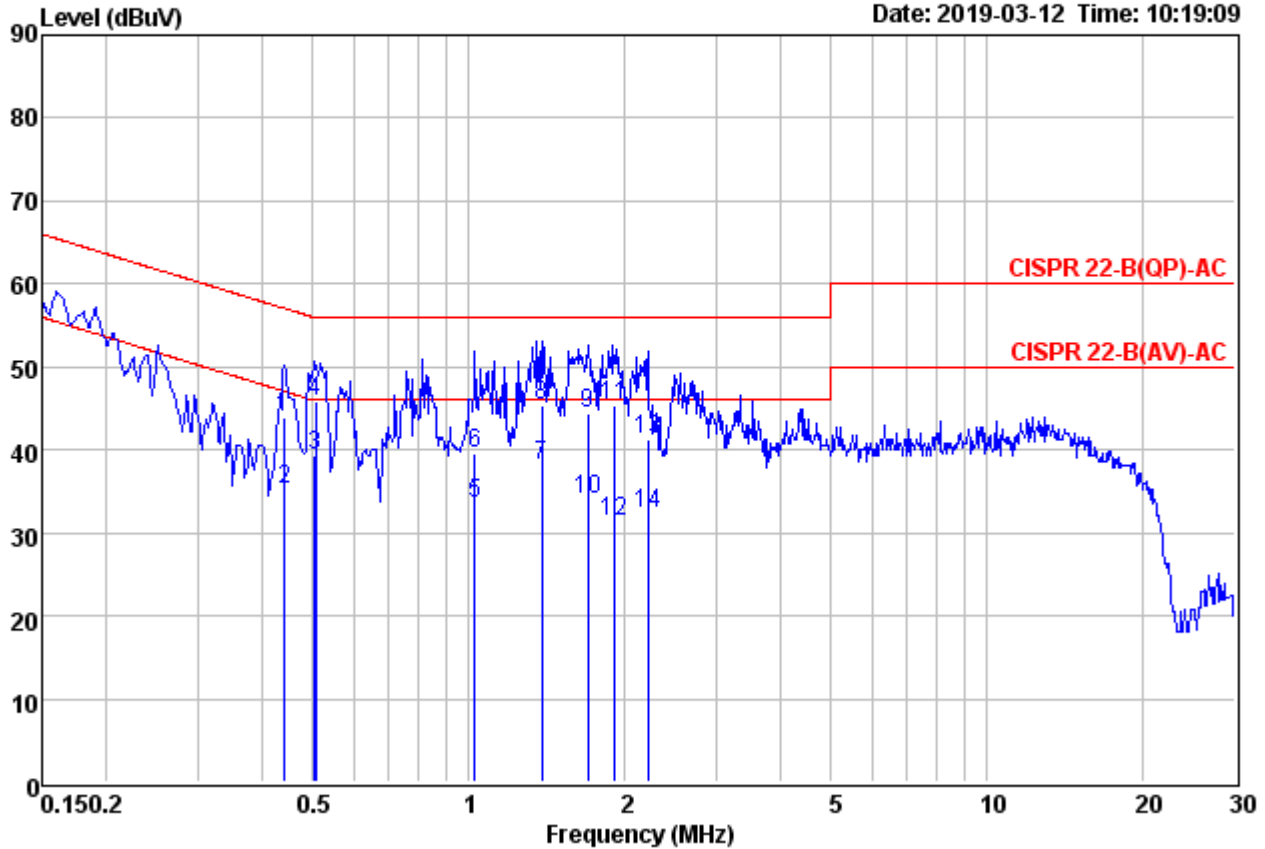

Site : site
 Condition : CISPR 22-B(QP)-AC NEUTRAL
 EUT : SKBB PSU 2nd source
 Test Mode : 220V/60Hz; 5V/1.6A
 Remark : Dummy load with Earth GND
 Sample No.:
 S/N :
 Test by : Martin Chang

	Read Freq	Level	LISN Factor	Cable Loss	Level	Limit Line	Over Limit	Pol/Phase	Remark
	MHz	dBuV	dB	dB	dBuV	dBuV	dB		
1	0.44	43.72	0.00	0.13	43.85	57.08	-13.23	NEUTRAL	QP
2	0.44	35.00	0.00	0.13	35.13	47.06	-11.93	NEUTRAL	Average
3	0.50	39.31	0.00	0.13	39.44	46.00	-6.56	NEUTRAL	Average
4	0.50	45.74	0.00	0.13	45.87	56.00	-10.13	NEUTRAL	QP
5	1.02	33.40	0.00	0.15	33.55	46.00	-12.45	NEUTRAL	Average
6	1.03	39.44	0.00	0.15	39.59	56.00	-16.41	NEUTRAL	QP
7	1.38	37.95	0.00	0.16	38.11	46.00	-7.89	NEUTRAL	Average
8	1.38	45.09	0.00	0.16	45.25	56.00	-10.75	NEUTRAL	QP
9	1.70	44.29	0.00	0.17	44.46	56.00	-11.54	NEUTRAL	QP
10	1.70	33.96	0.00	0.17	34.13	46.00	-11.87	NEUTRAL	Average
11	1.90	45.25	0.00	0.17	45.42	56.00	-10.58	NEUTRAL	QP
12	1.90	31.16	0.00	0.17	31.33	46.00	-14.67	NEUTRAL	Average
13	2.21	41.08	0.00	0.18	41.26	56.00	-14.74	NEUTRAL	QP
14	2.21	32.24	0.00	0.18	32.42	46.00	-13.58	NEUTRAL	Average