


Data: 89

Date: 2019-03-12 Time: 11:20:47

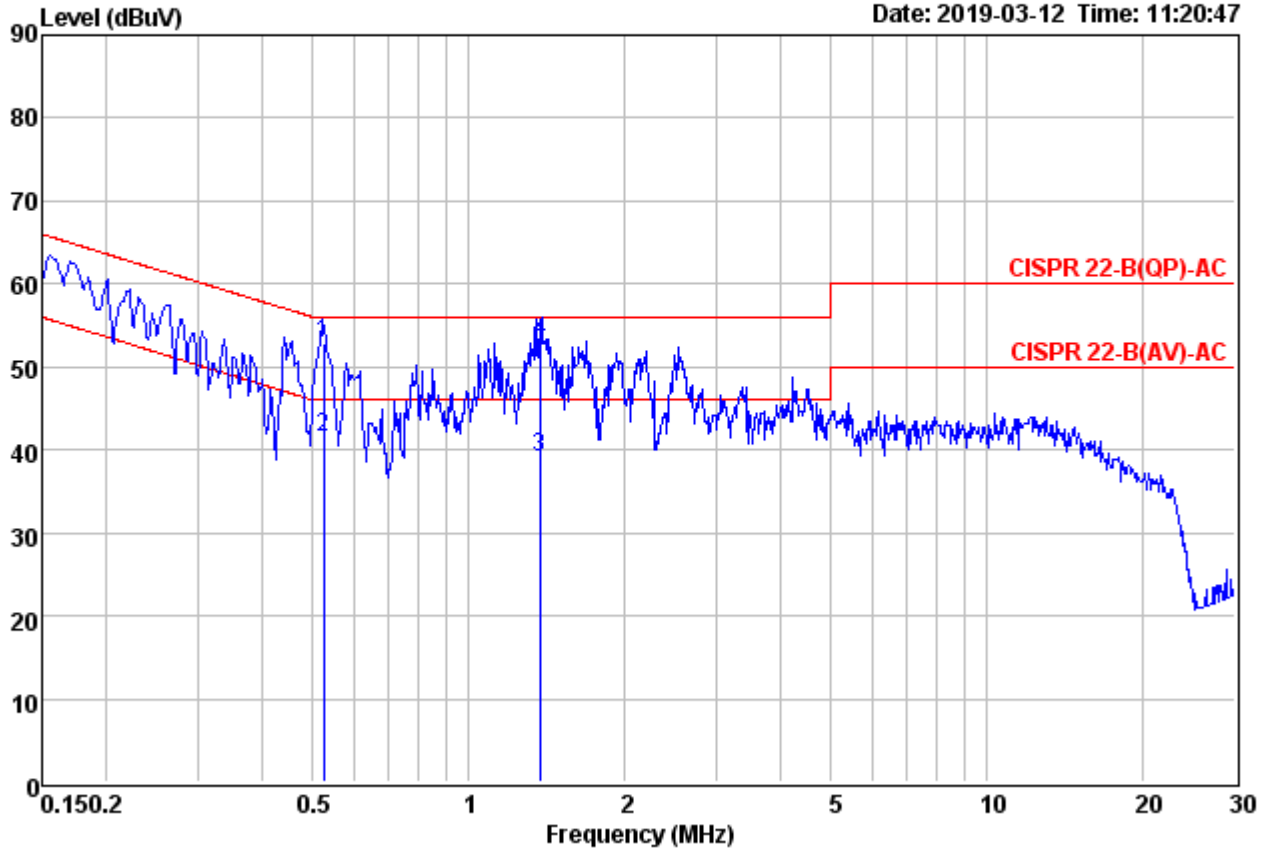

Site : site
 Condition : CISPR 22-B(QP)-AC NEUTRAL
 EUT : SKBB PSU 2nd source
 Test Mode : 220V/60Hz; 5V/1.6A
 Remark : Dummy load with Earth GND
 Sample No.: 04
 S/N : EdiTech / TYPE2541
 Test by : Martin Chang

	Read Freq	Level	LISM Factor	Cable Loss	Level	Limit Line	Over Limit	Pol/Phase	Remark
	MHz	dBuV	dB	dB	dBuV	dBuV	dB		
1	0.52	52.70	0.00	0.14	52.84	56.00	-3.16	NEUTRAL	QP
2	0.52	41.47	0.00	0.14	41.61	46.00	-4.39	NEUTRAL	Average
3	1.37	38.92	0.00	0.16	39.08	46.00	-6.92	NEUTRAL	Average
4	1.37	52.92	0.00	0.16	53.08	56.00	-2.92	NEUTRAL	QP