


Data: 93

Date: 2019-03-19 Time: 15:53:08

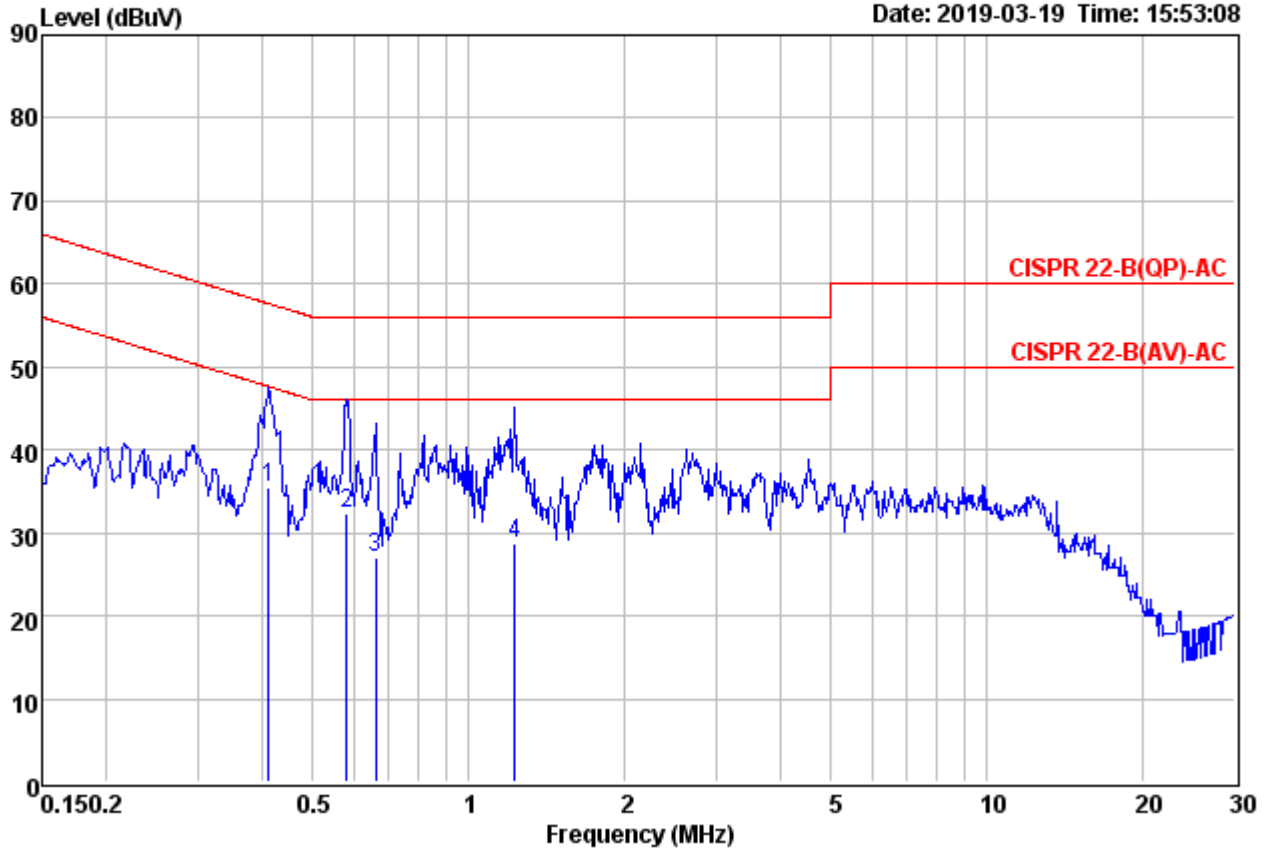

Site : site
 Condition : CISPR 22-B(QP)-AC NEUTRAL
 EUT : SKBB PSU 2nd source
 Test Mode : System level test @ 220V/60Hz
 Remark :
 Sample No.: 01
 S/N : EdiTech / TYPE2541
 Test by : Martin Chang

	Read Freq	Level	LISM Factor	Cable Loss	Level	Limit Line	Over Limit	Pol/Phase	Remark
	MHz	dBuV	dB	dB	dBuV	dBuV	dB		
1	0.41	35.25	0.00	0.13	35.38	47.64	-12.26	NEUTRAL	Average
2	0.58	32.23	0.00	0.14	32.37	46.00	-13.63	NEUTRAL	Average
3	0.66	26.97	0.00	0.14	27.11	46.00	-18.89	NEUTRAL	Average
4	1.22	28.60	0.00	0.16	28.76	46.00	-17.24	NEUTRAL	Average