


Data: 92

Date: 2019-03-19 Time: 15:43:24

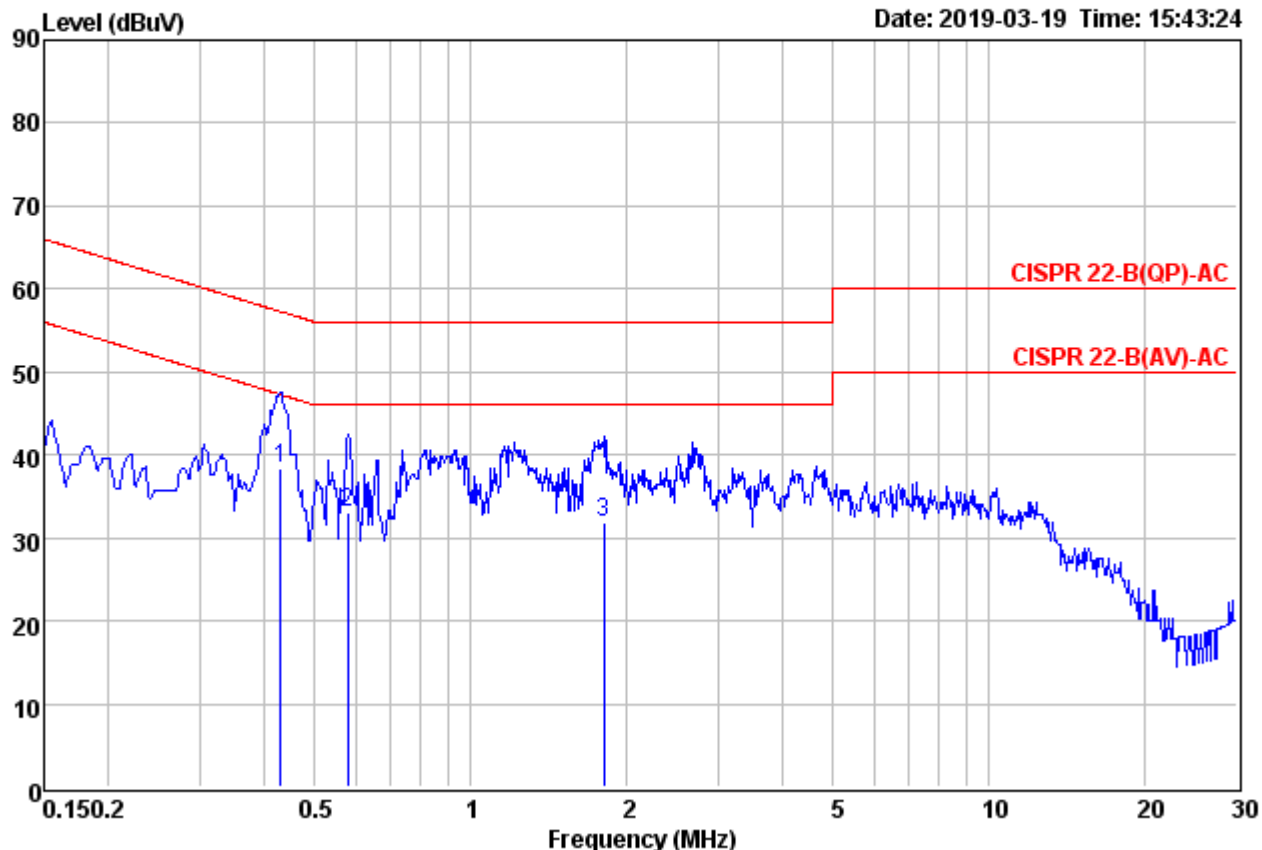

Site : site
 Condition : CISPR 22-B(QP)-AC NEUTRAL
 EUT : SKBB PSU 2nd source
 Test Mode : System level test @ 220V/60Hz
 Remark :
 Sample No.: 04
 S/N : EdiTech / TYPE2541
 Test by : Martin Chang

	Read Freq	Level	LISM Factor	Cable Loss	Level	Limit Line	Over Limit	Pol/Phase	Remark
	MHz	dBuV	dB	dB	dBuV	dBuV	dB		
1	0.43	38.15	0.00	0.13	38.28	47.26	-8.98	NEUTRAL	Average
2	0.58	32.89	0.00	0.14	33.03	46.00	-12.97	NEUTRAL	Average
3	1.80	31.67	0.00	0.17	31.84	46.00	-14.16	NEUTRAL	Average